


## RESIDENTIAL STREET

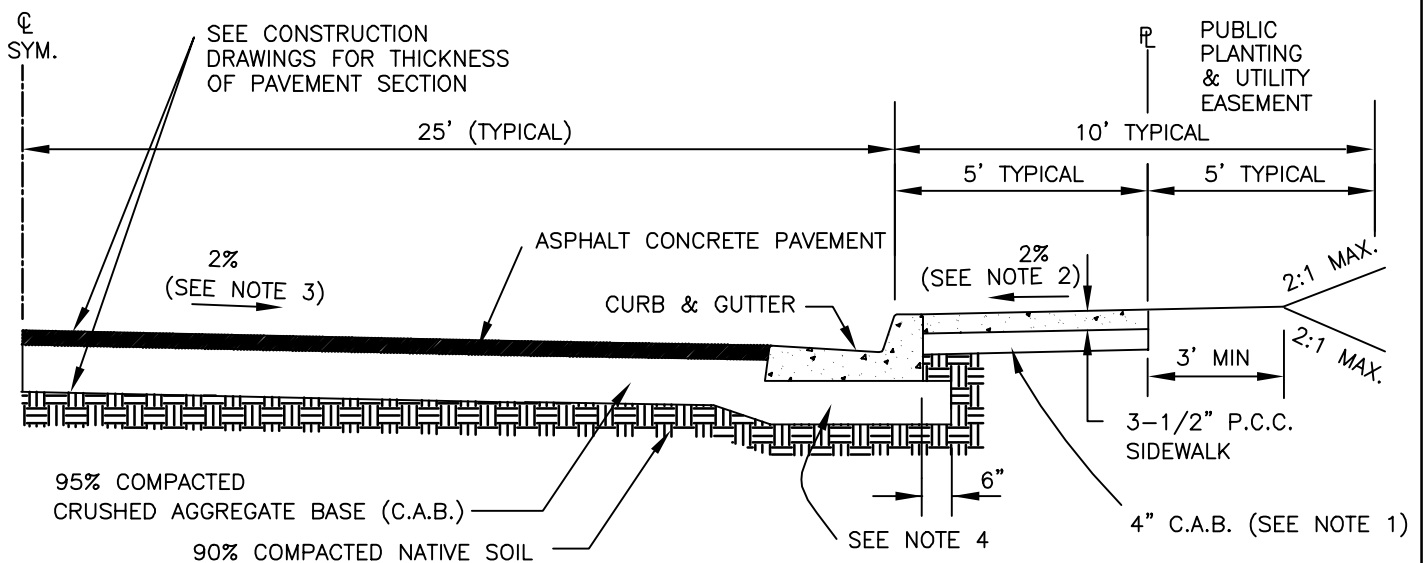

## INDUSTRIAL STREET

### NOTES:

1. THE BASE MAY BE OMITTED UNDER SIDEWALK IF SUBGRADE IS SANDY SOIL.
2. TYPICAL - MAY VARY 0.5% MIN. TO 2.0% MAX TO MATCH EXISTING CONDITIONS AND TO FACILITATE JOINS.
3. TYPICAL - MAY VARY 1% MIN. TO 4.0% MAX TO MATCH EXISTING CONDITIONS AND TO FACILITATE JOINS.
4. THICKNESS OF BASE REQUIRED UNDER CURB & GUTTER SHALL BE 8" ON CLAYEY SOILS AND 6" ON SANDY SOILS.

### CITY OF TORRANCE - ENGINEERING DEPARTMENT

DATE ISSUED  
16 NOV 1998

### TYPICAL SECTION LOCAL STREET

RICHARD W. BURTT  
ENGINEERING DIRECTOR  
R.C.E. NO. 32862

STANDARD NO.  
**T102-2**

SHEET 1 OF 1